


Appendix 4.4

Capacity usage of timetable period K16

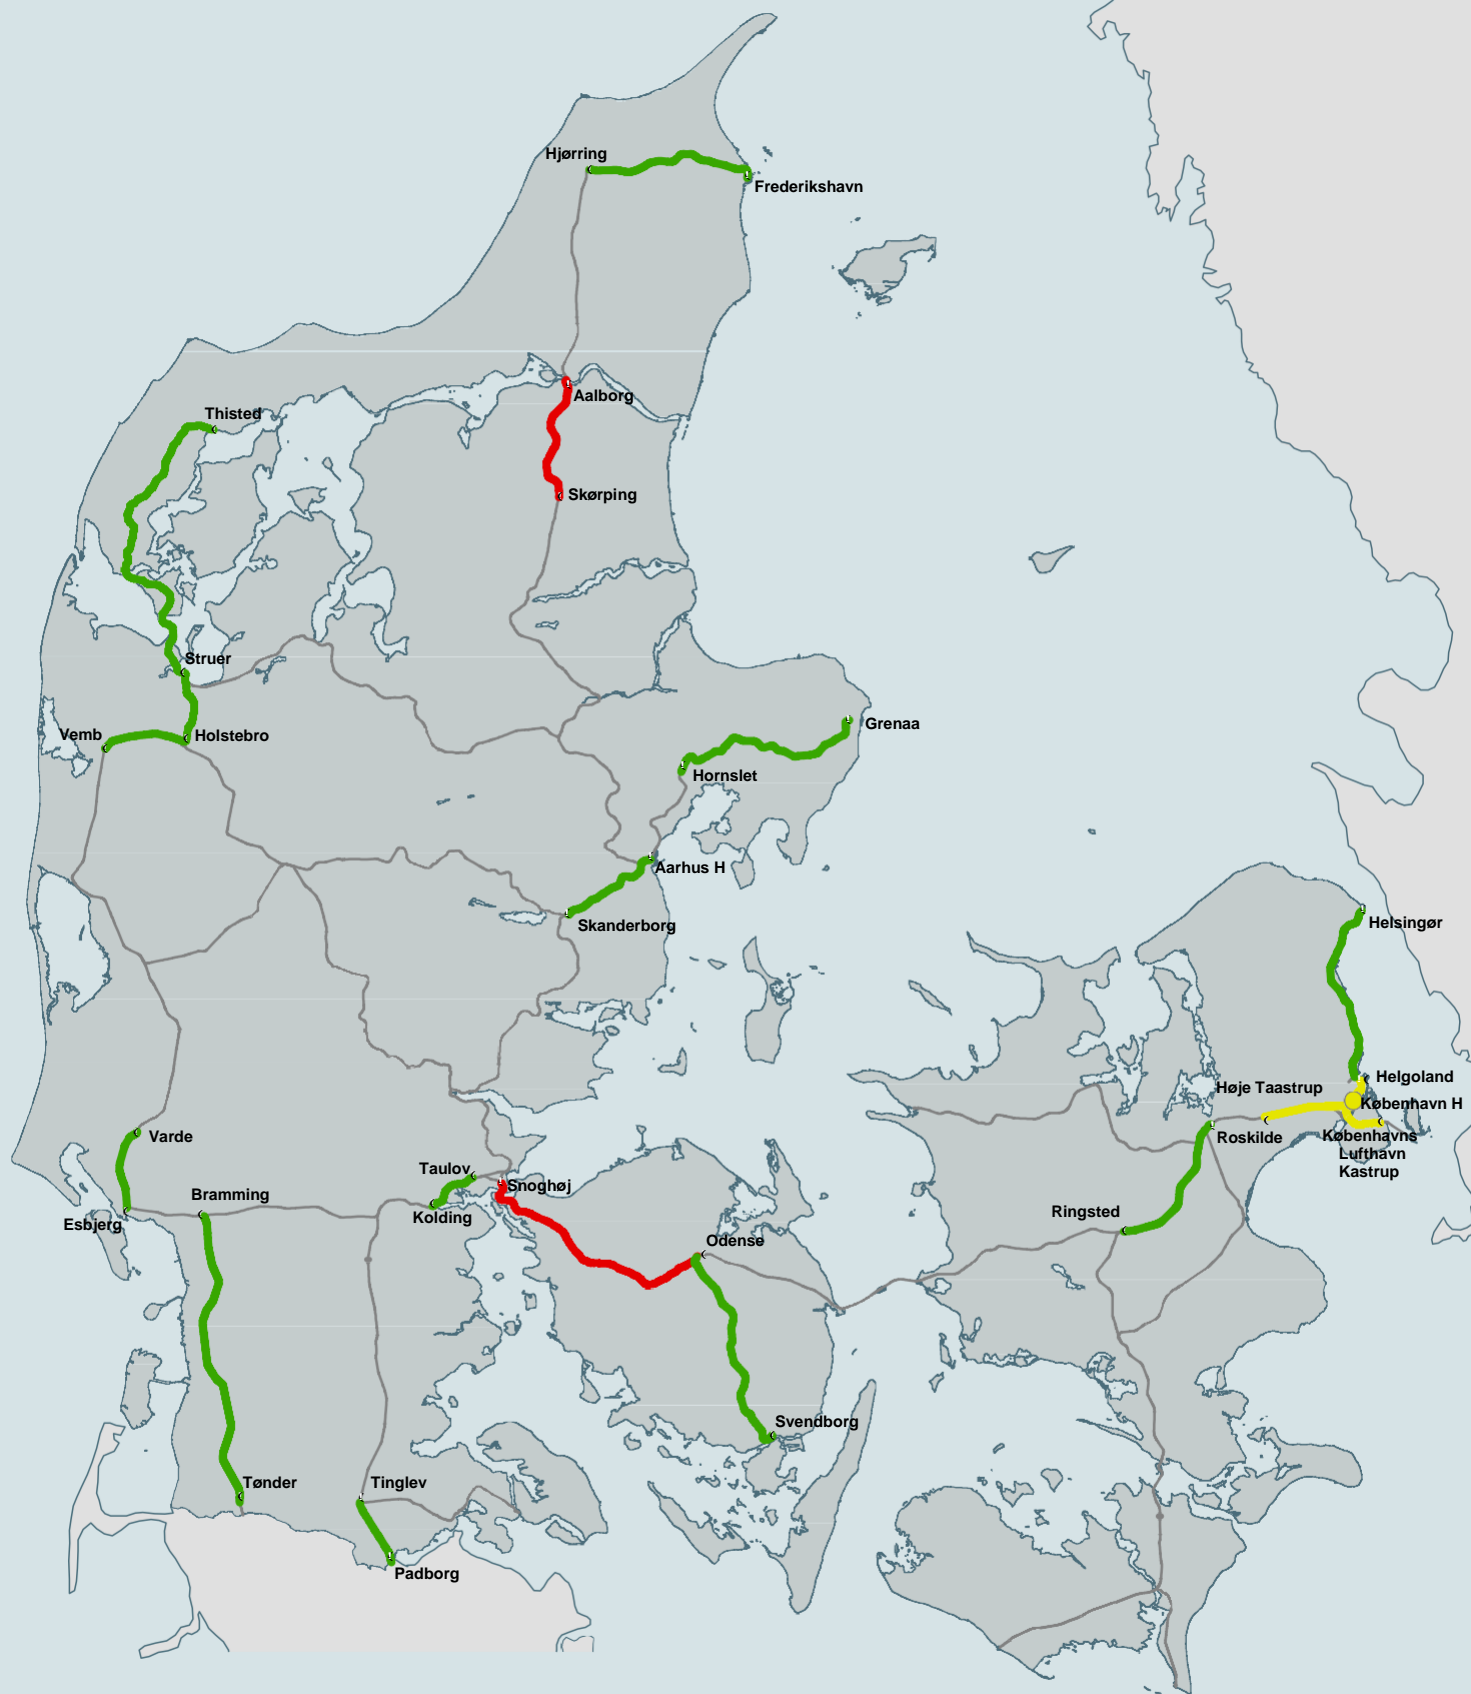

- Congested infrastructure
- Excess of UIC's maximum recommended usage
- Close to excess of UIC's maximum recommended usage

Valid till:
2017

Produced by:
Banedanmark, Banedata GIS
© Banedanmark d. 30.03.2016